

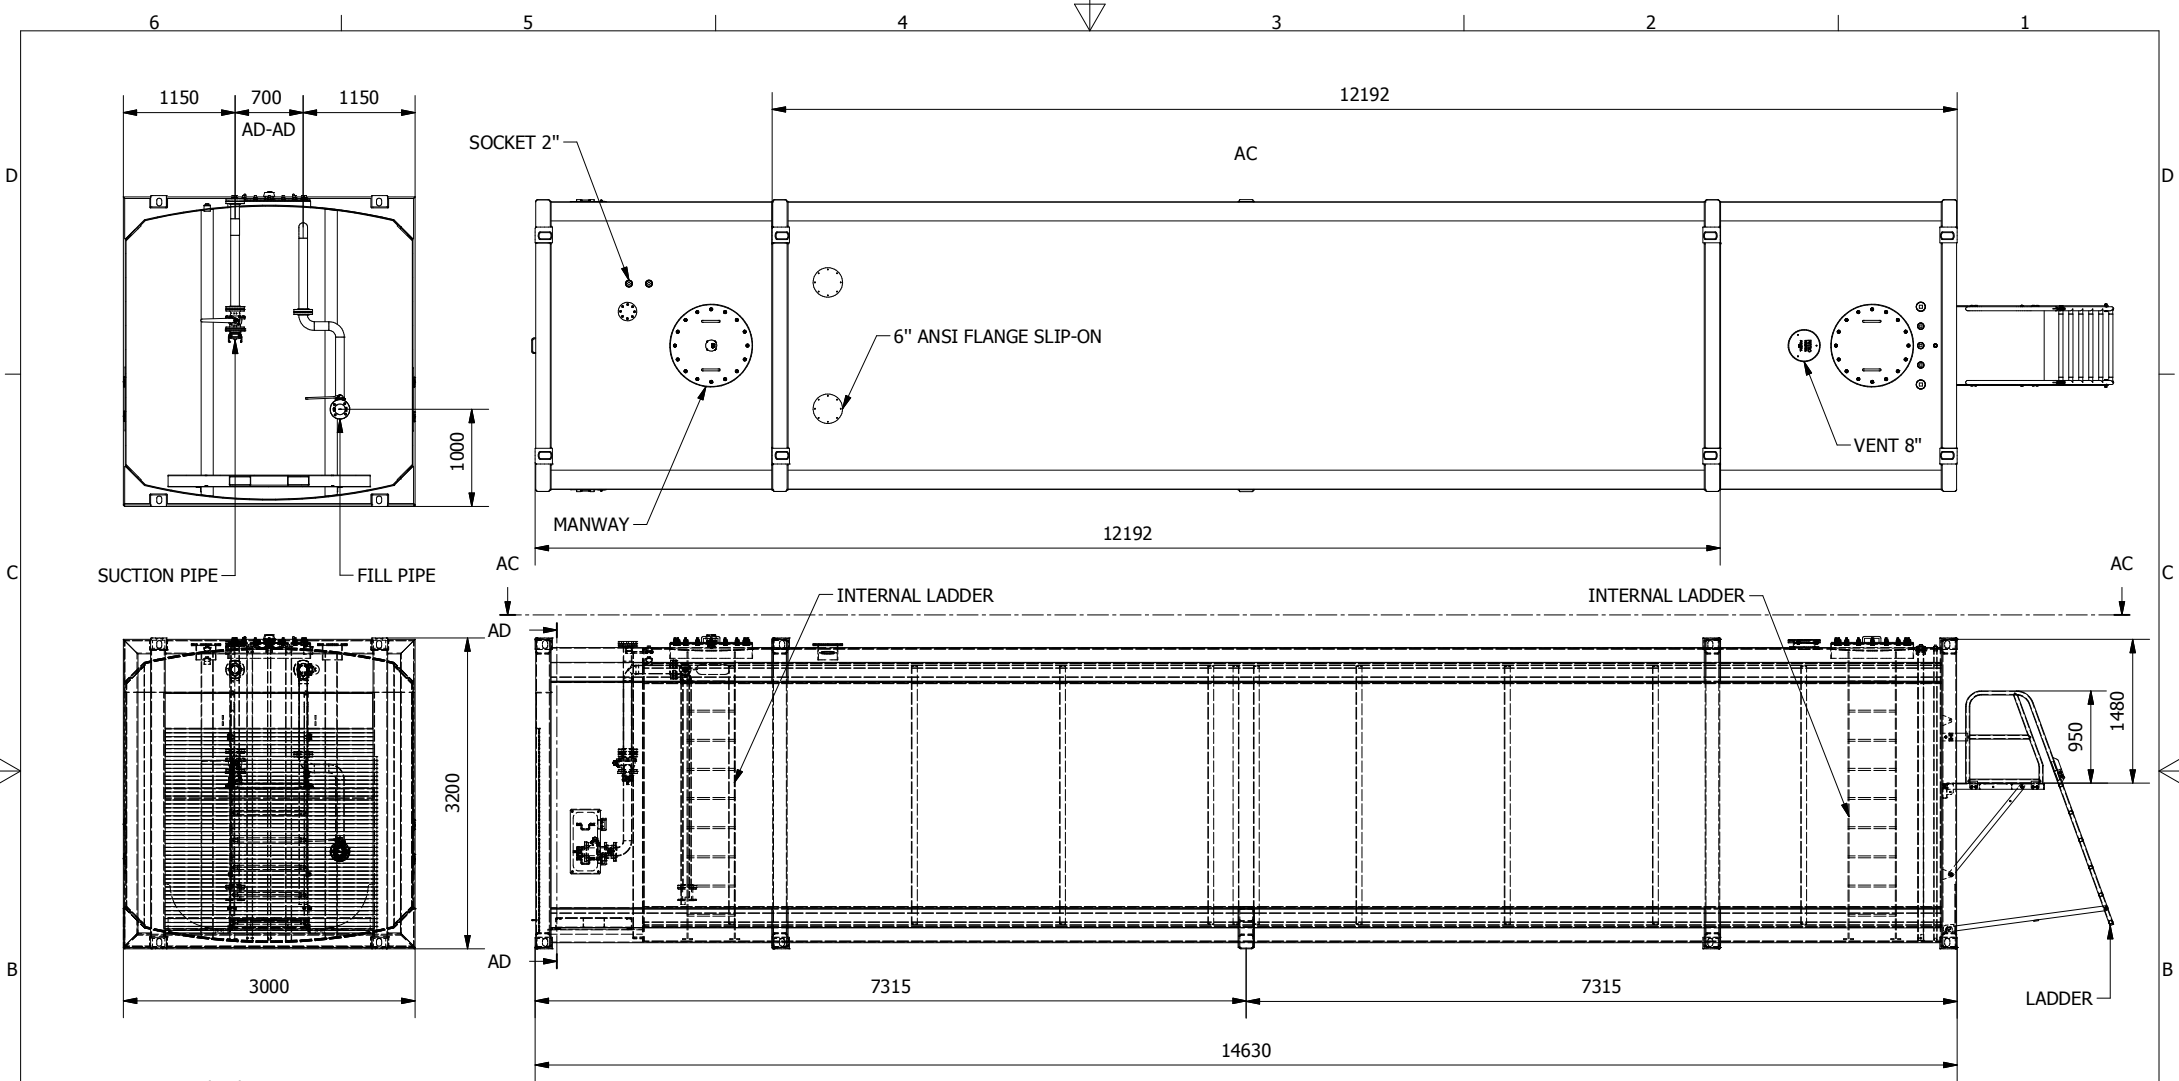


ALL WELDS TO BE 8 mm.(MIN)  
 FILLET OR BUTT WELDS  
 UNLESS STATED  
 OTHERWISE  
 ALL WELDS TO BE : AS1554  
 INTERSTITIAL LEAKAGE TEST AT 35 KPA



NOTE:  
 1: ACTUAL VOLUME: 111,693 L.  
 2: SFL (96.5%) VOLUME: 105,000 L.  
 3: TANK MASS: 21,093 KGS.

PART	FINISH	TOLERANCES: ALL DIMENSION IN MM	DRAWN CK	DATE 11-10-2012		TITLE 110,000 GO Self Bunded Tank
	MATERIAL		DESIGN/CHECKED	DATE		DRAWING NO HT110PB-0-0001
			APPROVED DB	DATE 11-10-2012		SHEET 1 OF REV-00
			CONFIGURED	DATE		



ALL WELDS TO BE 8 mm.(MIN)  
 FILLET OR BUTT WELDS  
 UNLESS STATED  
 OTHERWISE  
 ALL WELDS TO BE : AS1554  
 INTERSTITIAL LEAKAGE TEST AT 35 kPA

NOTE:  
 1: ACTUAL VOLUME: 111,693 L.  
 2. SFL (96.5%) VOLUME: 105,000 L.  
 3: TANK MASS: 21,093 KGS.

PART	FINISH	TOLERANCES: ALL DIMENSION IN MM	DRAWN	DATE	 TITLE 110,000 GO Self Bunded Tank
			CK	11-10-2012	
			DESIGN/CHECKED	DATE	
			APPROVED	DATE	
MATERIAL			DB	11-10-2012	DRAWING NO HT110PB-0-0002
			CONFIGURED	DATE	
			SCALE:	APPR MASS:	
					A3